



KZN Health &gt; Components &gt; Supply Chain Management

AdvertQuote


 KWAZULU-NATAL PROVINCE  
 HEALTH  
 REPUBLIC OF SOUTH AFRICA

## Quotation Advert

Opening Date: 2022-11-10

Closing Date: 2022-11-23

Closing Time: 11:00

## INSTITUTION DETAILS

Institution Name: Umkhanyakude district office

Province: KwaZulu-Natal

Department or Entity: Department of Health

Division or section: Central Supply Chain Management

Place where goods / services is required: UMKHANYAKUDE HEALTH DISTRICT OFFICE

Date Submitted: 2022-11-09

## ITEM CATEGORY AND DETAILS

 Quotation Number: ZNQ:  
 UMKH 063/20/21

Item Category: Services

Item Description: REPAIR LIGHT AND GENERAOTOR

Quantity (If supplies): AS ABOVE

## COMPULSORY BRIEFING SESSION / SITE VISIT

Select Type: Compulsory Briefing Session

Date: 2022-11-16

Time: 10:00 AM

Venue: Umkhanyakude Health Sub-District Office Next To Boxer Store

QUOTES CAN BE COLLECTED FROM: ON SITE ONLY

QUOTES SHOULD BE DELIVERED TO: Umkhanyakude Health Sub-District Office Tender Box,Fax or Email

## ENQUIRIES REGARDING THE ADVERT MAY BE DIRECTED TO:

Name: T L Mkhabela

Email: umkhanyakude.quotationscm@kznhealth.gov.za

Contact Number: 035 572 1042

Finance Manager Name: B Mthembu

Finance Manager Signature:

No late quotes will be considered



**health**

Department:  
Health  
PROVINCE OF KWAZULU-NATAL

DIRECTORATE: Umkhanyakude District Office

Mr. M Mkhwanazi

Physical Address: Jozini Main Road  
Postal Address: Private Bag X026, Jozini, 3969  
Tel: (035)572 1327 Fax: (035)572 1364 Email: musandongaz2@gmail.com  
www.kznhealth.gov.za

Repair Lights and Generator at the Sub District

**Requirements**

1. Companies to comply with CSD
2. Companies to have valid minimum 1EB OR 1EP
3. Companies to have valid letter of good standing with the Department of Labor (Compensation commissioner)
4. Companies to have valid registration with the Department of Labor as registered Electrical Contractors
5. Companies must have valid Public Liability insurance with the minimum of R 3 000 000

**Specification**

1. Replace 20 Amps circuit Breaker
2. Replace photo cell
3. Replace the contactor
4. Trace the fault light are tripping
5. Take out the light pole and mount it again straight
6. Allow five light fittings new one as per sample
7. Repair Lights
8. All the above are in the kiosk behind the office
9. Generator
10. Change Oil Filter
11. Change Diesel Filters
12. Change oil
13. Clean the engine
14. Change the battery
15. Fit 100 Black Breaker ( The breaker should be marked CBI)
16. All Breakers used must be marked CBI
17. Supply New HA1 Pad locks with 3 keys Each

Item	Description	unites	Unit price	Total price	
1	Replace 20 Amps Breaker	1			
2	Replace Photo Cell	1			
3	Replace Contactor For Lights	1			



4	Trace fault for tripping lights	10			
5	Take Out Lights and make t straight	1			
6	New Lights fittings as per attached sample and globes	5			
7	Repair Lights	10			
8	COC ( Electrical Compliance Certificate)	Item			
9	Replace 100 Amps	1			
10	Repair Generator	1			
11	Supply HA1 Key with 3 keys	5			
12	Connect forensic to the generator	item			
		Total			
		VAT			
		Total			

Thanks

*Musa Mkhwanazi*  
Musa Mkhwanazi


0732778344

22 June 2022

---

• KINDLY RETURN ALL DOCUMENTATION WHEN REPLYING

*McDonald*

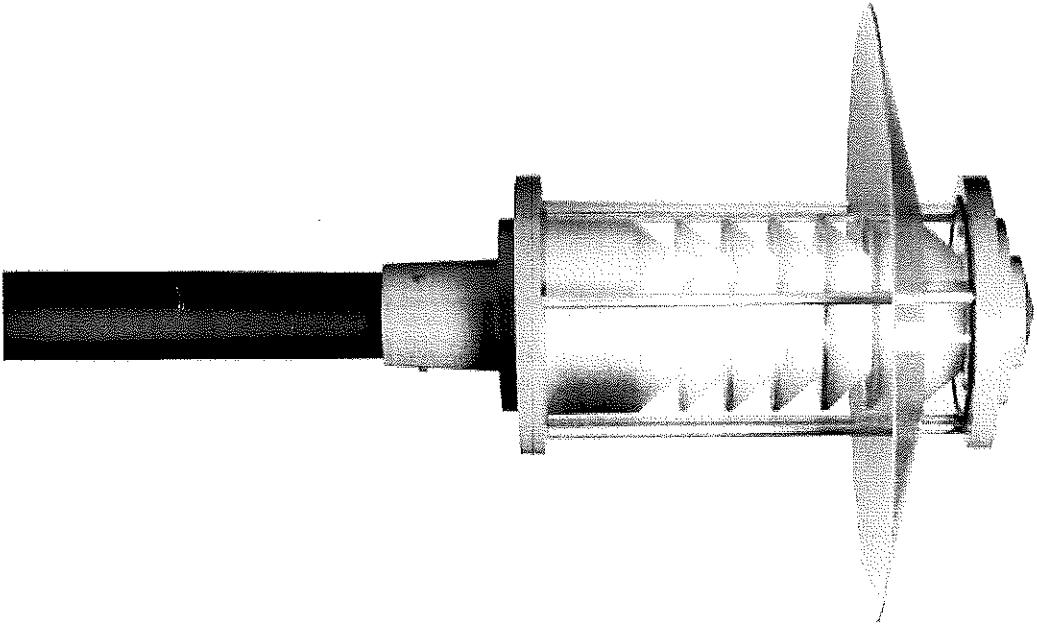

SERIAL NUMBER:	WR13130457
FRAME/CORE:	WR184F16
KVA BASE RATE(BR):	27.5
KW BASE RATE(BR):	22.0
HZ:	50
RPM:	1500
VOLTS:	380
PHASE:	3
AMPS BASE RATE(BR):	42
PF:	0.8
RATING:	CONT
EX. VOLTS:	45
EX.AMPS:	2.3
AMBIENT TEMP.°C:	40
ENCLOSURE:	IP23
INSULATION CLASS:	H
STATOR WDG.:	311
STATOR CONN.:	S STAR
AVR:	SX460
MOUNTING TYPE:	IMB15
COOLING METHOD:	IC01
WEIGHT Kg:	150

*Wuxi Werna*

# WERNNA®

Wuxi Werna Alternator Co., Ltd  
 NO.13 Chunsun West Road Xishan Economic  
 Development Zone Wuxi City, Jiangsu Prov, China  
[www.werna.cn](http://www.werna.cn)

## WARNING

REFER TO THE INSTRUCTION BOOK BEFORE  
 FLASH OR MEGGER TESTING

BS5000:PART 3 IEC 34-1  
 NEMA MG1-32 ISO 8528-3



ISO9000